

Annexure C

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No.

Dated:

It is certified that an inspection team headed by Deepan Sharma (Chemist) & Lalit K...(Name of Officers with designation) from Distt. Lab G.B. Nagar.....PHEDinspected the Deshraj Public School, Sec-1, Bisraakh Greater Noida (W) G.B Nagar U.P(Name & Address of the school) on 20.09.2025.....(date of inspection) and on the basis ofWater Test Report (Attached) bearing no. 25.09.2025/115..... dated 25.09.2025.of U.P. Jal Nigam (ग्रामिण) G.B. Nagar (PHED Lab) certified thatthe Deshraj Public School G.B. Noida (W).....(Name of school) has safe drinking water

facilities for the students and members of staff of the institution. School is also maintains the

hygienic sanitation condition in the school building & the campus as per norms prescribed by the

Central/ State/ U.T. Govt.

This certificate is valid till 24.09.2026.....

Signature with Seal:
 Name :
 Designation :
 Name & Address of the Office / Department :

To
Deshraj Public School Sec-1
Bisraakh G.B. Noida (W) G.B. Nagar U.P
 (Name & Address of the Institution)

Assistant Engineer
Division Office
U.P Jal Nigam (Gramin)
G.B. Nagar

Note: The certificate is to be issued by authorized officer / PHED Lab / local bodies



Deshraj Public School
 Manager



SHRI OM TESTING & RESEARCH LABORATORY

Plot No. 296, 1st FNG Road, Sector-121, Ghari Chaukhandi, Noida-201301

Mob.: 9821154906, 8076937396

E-mail.: shriomlab@gmail.com, Web.: www.shriomlab.com, www.shriomlab.in

GSTIN: 09ADHFS2444J1ZS

N.A.B.L. Accredited, ISO 9001, ISO 14001 & ISO 45001 Certified Laboratory.

TEST REPORT

ISSUED TO : DESHRAJ PUBLIC SCHOOL
ADDRESS : SEC -1, BISRAKH JALALPUR , GREATER NOIDA
WEST , GAUTAM BUDDHA NAGAR UTTAR PRADESH 203207

REPORT NO : 25092025015
ISSUED DATE : 25.09.2025

(WATER ANALYSIS REPORT)

SAMPLING DETAILS

Sample Description
Sample received on
Sample Collected by
Sampling Quantity
Analysis Duration
Valid Up to

RESULTS

: Potable Water (Ground Water)
: 20.09.2025
: Ravinder Kumar
: 2.0 Ltr
: 20.09.2025 to 25.09.2025
: 24.09.2026

S. No.	Parameters	Units	Limits (as per IS:10500-2012)		Results	Test Methods
			Desirable Limit	Permissible Limit		
1	Color	--	--	--	0.1	IS : 3025(Pt-4) 1983, Reaff. 2017
2	Odour	-	Agreeable	Agreeable	Agreeable	IS : 3025(Pt-5) 1983, Reaff. 2017
3	Taste	-	Agreeable	Agreeable	Agreeable	IS : 3025(Pt-8)-1984, Reaff. 2017
4	Temperature	°C	-	-	23.8	IS: 3025(Pt-9)1984 Reaff 2002
5	pH	-	6.5-8.5	No Relaxation	7.45	IS : 3025(Pt-11)1983, Reaff. 2017
6	Electric Conductivity	μhos/cm	-	-	856	IS : 3025 (Pt-14)-2013
7	Total Hardness (as CaCO ₃)	mg/l	200	600	204.4	IS : 3025(Pt-21)1983, Reaff. 2014
8	Iron (as Fe)	mg/l	0.3	No Relaxation	0.15	APHA 22 nd Ed., 3120B (3111B (AAS),
9	Chlorides (as Cl)	mg/l	250	1000	190.2	IS : 3025(Pt-32)1988, Reaff. 2014
10	Fluoride (as F)	mg/l	1	1.5	< 0.05	APHA 22 nd Ed., 4500F(D)
11	TDS	mg/l	500	2000	510.2	IS: 3025(Pt-16)1984, Reaff. 2017
12	Calcium (as Ca ²⁺)	mg/l	75	200	38.7	IS :3025(Pt-40)1991, Reaff. 2014
13	Magnesium (as Mg ²⁺)	mg/l	30	100	26.3	APHA 22 nd Ed., 3500-Mg (B)
14	Sulphate (as SO ₄)	mg/l	200	400	24.0	IS : 3025(Pt-24)1986, Reaff. 2014
15	Nitrate(as NO ₃)	mg/l	45	No Relaxation	22.0	IS : 3025(Pt-34)1988, Reaff. 2014
16	Alkalinity (as CaCO ₃)	mg/l	200	600	178.2	IS: 3025(Pt-23)1986, Reaff. 2014
Bacteriological Parameters						
1	Total Coli form	MPN/100ml	Shall Not Be Detectable	Not Detected (<2)	IS : 1622-1981 (Reaff.2003)	
2	<u>E.coli</u>	<u>E.coli</u> /100ml	Shall Not Be Detectable	Absent	IS : 1622-1981 (Reaff-2003)	


Remark :- The Sample Confirms as per IS 10500-2012 Specification for above test only

End of Report Page(01 of 01)


Principal
Deshraj Public School

Deshraj Public School

Shri Om Testing & Research Laboratory
Ravinder Kumar Sharma


25/09/25
Technical Manager

Authorised Signatory
(Name, Designation & Signature with Seal)



SHRI OM TESTING & RESEARCH LABORATORY

Plot No. 296, 1st FNG Road, Sector-121, Ghari Chaukhandi, Noida-201301

Mob.: 9821154906, 8076937396

E-mail.: shriomlab@gmail.com, Web.: www.shriomlab.com, www.shriomlab.in

GSTIN: 09ADHFS2444J1ZS

N.A.B.L. Accredited, ISO 9001, ISO 14001 & ISO 45001 Certified Laboratory.

TEST REPORT

ISSUED TO : DESHRAJ PUBLIC SCHOOL
ADDRESS : SEC -1, BISRAKH JALALPUR , GREATER NOIDA
WEST , GAUTAM BUDDHA NAGAR UTTAR PRADESH 203207

REPORT NO : 25092025014
ISSUED DATE : 25.09.2025

(WATER ANALYSIS REPORT)

SAMPLING DETAILS


Sample Description : Drinking Water (RO Water)
Sample received on : 20.09.2025
Sample Collected by : Ravinder Kumar
Sampling Quantity : 2.0 Ltr
Analysis Duration : 20.09.2025 to 25.09.2025
Valid Up to : 24.09.2026

RESULTS

S. No.	Parameters	Units	Limits (as per IS:10500-2012)		Results	Test Methods
			Desirable Limit	Permissible Limit		
1	Color	--	--	--	0.1	IS : 3025(Pt-4) 1983, Reaff. 2017
2	Odour	-	Agreeable	Agreeable	Agreeable	IS : 3025(Pt-5) 1983, Reaff. 2017
3	Taste	-	Agreeable	Agreeable	Agreeable	IS : 3025(Pt-8)-1984, Reaff. 2017
4	Temperature	°C	-	-	20.6	IS: 3025(Pt-9)1984 Reaff 2002
5	pH	-	6.5-8.5	No Relaxation	7.20	IS : 3025(Pt-11)1983, Reaff. 2017
6	Electric Conductivity	µhos/cm	-	-	146	IS : 3025 (Pt-14)-2013
7	Total Hardness (as CaCO ₃)	mg/l	200	600	41.0	IS : 3025(Pt-21)1983, Reaff. 2014
8	Iron (as Fe)	mg/l	0.3	No Relaxation	0.12	APHA 22 nd Ed., 3120B (3111B (AAS),
9	Chlorides (as Cl)	mg/l	250	1000	38.6	IS : 3025(Pt-32)1988, Reaff. 2014
10	Fluoride (as F)	mg/l	1	1.5	0.01	APHA 22 nd Ed., 4500F(D)
11	TDS	mg/l	500	2000	84.7	IS: 3025(Pt-16)1984, Reaff. 2017
12	Calcium (as Ca ²⁺)	mg/l	75	200	12.0	IS :3025(Pt-40)1991, Reaff. 2014
13	Magnesium (as Mg ²⁺)	mg/l	30	100	2.68	APHA 22 nd Ed., 3500-Mg (B)
14	Sulphate (as SO ₄)	mg/l	200	400	30.2	IS : 3025(Pt-24)1986, Reaff. 2014
15	Nitrate(as NO ₃)	mg/l	45	No Relaxation	16.6	IS : 3025(Pt-34)1988, Reaff. 2014
16	Alkalinity (as CaCO ₃)	mg/l	200	600	54.6	IS: 3025(Pt-23)1986, Reaff. 2014
Bacteriological Parameters						
1	Total Coli form	MPN/100ml	Shall Not Be Detectable	Not Detected (<2)	IS : 1622-1981 (Reaff.2003)	
2	<u>E.coli</u>	<u>E.coli</u> /100ml	Shall Not Be Detectable	Absent	IS : 1622-1981 (Reaff-2003)	

Remark :- The Sample Confirms as per IS 10500-2012 Specification for above test only

End of Report Page(01 of 01)

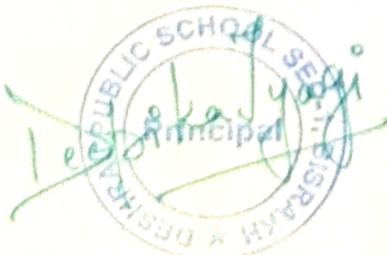

Deshraj Public School
Manager

Shri Om Testing & Research Laboratory
Ravinder Kumar Sharma
Technical Manager

Authorised Signatory
(Name, Designation & Signature with Seal)